


Dyson Janzen ARCHITECTS, INC.
1295 N. Wishon Ave
FRESNO, CA 93728
(559) 497-6370 FAX (559) 486-4909

DATE: August 27, 2018

PROJECT:

SELMA POLICE DEPARTMENT
2055 3rd Street, Selma, CA 93662
FOR
CITY OF SELMA
1710 Tucker Street, Fresno, CA 93662

ADDENDUM NO. 3

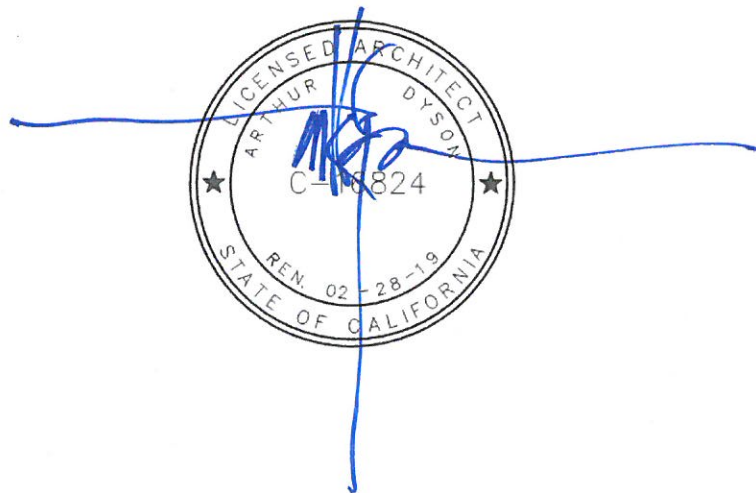

Arthur T. Dyson, AIA, Architect C-16824
Dyson Janzen Architects, Inc.

Dyson Janzen ARCHITECTS, INC.
1295 N. Wishon Ave
FRESNO, CA 93728
(559) 497-6370 FAX (559) 486-4909

ADDENDUM NO. 3 (AD-3):

In accordance with instructions presented for Addenda, the following additions, deletions, or modifications shall become part of the Contract Documents for this project and incorporated in the bid.

ITEM NO. 01: STRUCTURAL ADDENDUM ITEMS

1. Incorporate the following structural revisions:
 - a. SHEET S100: Revise note 3.CONCRETE, item B.1. – deformed ASTM A615 or A706 – Grade 60, #3 bar may be Grade 40 or Grade 60.
 - b. Sheet S100: Revised note 3.CONCRETE, item C – Aggregate for “TYPICAL ELEVATED FLOOR SLAB” TO BE REVISED TO C330, SIZE 57 OR SIZE 8.
 - c. STRUCTURAL STEEL SPECIFICATION Section 05 12 00, Part 2, item F – Revised grade of structural steel tubes to ASTM A500, Grade C.

ITEM NO. 02: MECHANICAL ADDENDUM ITEMS

1. See attached letter dated 8/27/ 2018 from Lawrence Engineering Group.

END OF ADDENDUM NO. 3



August 27, 2018

Ms. Mayuko Russell
 Darden Architects
 6790 N. West Avenue
 Fresno, CA 93711

17052

Project: City of Selma
 New Selma Police Department

Dear Ms. Russell:

Please include the following items in your next published addendum for this project:

1. Refer to Sheet M-6, Outdoor Unit Schedule: Replace the schedule with the following schedule.

OUTDOOR UNIT SCHEDULE		
DESIGNATION	ODU-1	ODU-2
MCA (AMPS)-(CIRCUIT A/B/C)	61.9 / 43 / 38	43 / 30.2
FLA (AMPS)-(CIRCUIT A/B/C)	41.8 / 30 / 27.4	30 / 20.2
VOLTS/PHASE	208/3	208/3
MAX FUSE SIZE-(CIRCUIT A/B/C)	70 / 50 / 45	50 / 35
COOLING CAP (MBH)	365.1	145.4
EER/IEER (AT ARI)	9.8 / 18.1	12.5 / 20.4
AMBIENT (°F)	105	105
HEATING CAPACITY (MBH)	355.2	194.9
COP AT 47	3.2	3.67
COP AT 17	2.05	2.38
REFRIGERANT	R-410A	R-410A
MANUFACTURER	DAIKIN	DAIKIN
TYPE	HEAT RECOVERY	HEAT RECOVERY
MODEL NUMBER	REYQ384TATJU	REYQ192TTJU
LOCATION	ROOF	ROOF
OPER. WT (LBS)	2195	1410
ACCESSORIES	1	1
1. OUTDOOR UNIT CONNECTION KIT		
2. BACNet INTERFACE WITH DIDO MODULE FOR CONNECTION TO THE ERV AND HC UNITS.		

Ryan W. Carlson, P.E. | Michael D. Cantelmi, P.E.

1. Refer to Sheet M-6, Variable Refrigerant Volume Schedule:

- a. Delete the Optional Economizer Kit from the Schedule Notes.
- b. Provide all units with the optional filter box and filters for MERV 8 filters.

Sincerely

A handwritten signature in blue ink, appearing to read "Michael Cantelmi". The signature is stylized with a large, circular flourish at the end.

Michael Cantelmi, P.E.